# HFE20

# MINIATURE HIGH POWER LATCHING RELAY





File No.: 40031831

Electrical endurance



## Features

- 16A switching capability
- Latching relay
- Max.inrush current Capacitor 500A/2ms (Contact material: W+AgSnO<sub>2</sub>)
- Environmental friendly product (RoHS compliant)
- Outline Dimensions: (29.0 x 12.7 x 15.7)mm

CONTACT DATA			
Contact arrangement	1A, 1B, 1C		
Contact resistance	20mΩ max. (at 1A 24VDC)		
Contact material	AgSnO2, W+AgSnO2		
Contact rating	1A,1B: 16A 250VAC,1 x 10 <sup>5</sup> oPs(Resistive) 20A 250VAC,2 x 10 <sup>4</sup> oPs(Resistive) 1.5HP 250VAC 4 x 10 <sup>4</sup> oPs(Motor) 8A 220VAC COSØ=0.4, 1x10 <sup>5</sup> oPs(Inductive) HFE20-1/X-1HD: 3300W 277VAC, 2 x 10 <sup>4</sup> oPs (Electronic rectifier) 1C: 16A 250VAC,5 x 10 <sup>4</sup> oPs(Resistive)		
Max. switching voltage	277VAC		
Max. switching current	20A		
Max. switching power	4000VA		
Mechanical endurance	1 x 10 <sup>6</sup> ops		

CHARACTERISTICS				
Insulation resistance		esistance	1000MΩ (at 500VDC)	
otropath	etween coil & contacts	4000VAC 1min		
	В	etween open contacts	1000VAC 1min	
Creepage distance		distance	8mm	
Operate time (at nomi. volt.)		ne (at nomi. volt.)	15ms max.	
Release time (at nomi. volt.)		ne (at nomi. volt.)	15msmax.	
Shock resistance	Functional	98m/s <sup>2</sup>		
	Destructive	980m/s <sup>2</sup>		
Vibration resistance		esistance	10Hz to 55Hz 1.5mm DA	
Humidity			5% to 85% RH	
Ambient temperature		mperature	PCB	
Termination		1	-40°C to 85°C	
Unit weight			Approx. 13g	
Construction		n	Plastic sealed, Flux proofed	
Mater. The	. م	ata abaum abaua ara initi	al valuas	

COIL	
Coil power	Single coil latching: Approx 400mW
	Double coils latching: Approx 600mW

COIL DATA at 23°C					
Nominal Voltage VDC	Set / Reset Voltage VDC max.	Pulse Duration ms min.			
3	2.4	50		22.5	
5	4.0	50	Single coil latching	62.5	
6	4.8	50		90	
9	7.2	50		202.5	
12	9.6	50		360	
24	19.2	50		1440	
3	2.4	50		15+15	
5	4.0	50	Double coils	42+42	
6	4.8	50		60+60	
9	7.2	50		135+135	
12	9.6	50	240+24		
24	19.2	50		886+886	
	Nominal Voltage VDC  3 5 6 9 12 24 3 5 6 9 12	Nominal Voltage VDC         Set / Reset Voltage VDC max.           3         2.4           5         4.0           6         4.8           9         7.2           12         9.6           24         19.2           3         2.4           5         4.0           6         4.8           9         7.2           12         9.6	Nominal Voltage VDC         Set / Reset Voltage VDC max.         Pulse Duration ms min.           3         2.4         50           5         4.0         50           6         4.8         50           9         7.2         50           12         9.6         50           24         19.2         50           3         2.4         50           5         4.0         50           6         4.8         50           9         7.2         50           12         9.6         50	Nominal Voltage VDC         Set / Reset Voltage VDC max.         Pulse Duration ms min.         Coil Resix x (1±10 ms min.           3         2.4         50           5         4.0         50           6         4.8         50           9         7.2         50           12         9.6         50           24         19.2         50           3         2.4         50           5         4.0         50           6         4.8         50           6         4.8         50           9         7.2         50           12         9.6         50	

SAFETY APPROVAL RATINGS			
UL/CUL	1H	20A 250VAC at 70°C	
		16A 250VAC at 85°C	
		1.5HP 250VAC at 40°C	
		NO:20A 250VAC at 70°C	
	1Z	16A 250VAC at 85°C	
		NC:16A 250VAC at 85°C	
VDE	1H	20A 250VAC(COSØ=1) at 70°C	
		16A 250VAC(COSØ=1) at 85°C	
		8A 250VAC (COSØ=0.4) at 85°C	
	1Z	16A 250VAC(COSØ=1) at 85°C	

**Notes:** Only some typical ratings are listed above. If more details are required, please contact us.

Notes: The data shown above are initial values.




HONGFA RELAY

ISO9001、ISO/TS16949、ISO14001、OHSAS18001、IECQ QC 080000 CERTIFIED

See "Contact rating"

2013 Rev. 1.00

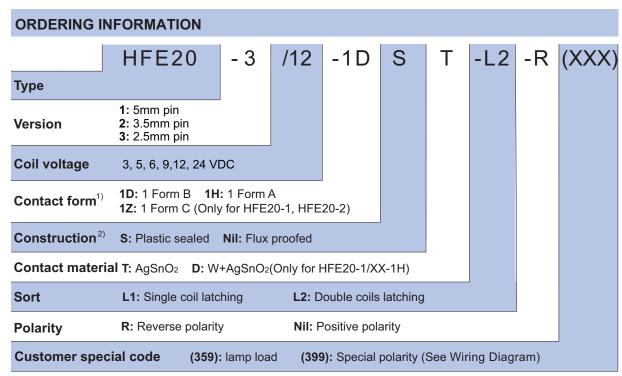

Notes: 1) 1H means that relay is on the "reset" status when delivery; 1D means that relay is on the "set" status when delivery. we will recommend use one form B if customer can use normally (except the pre-make version HFE20-1/XX-1HXD).


2) If water cleaning is required after the relay is assembled on PCB, please contact us for suggestion about suitable parts.

# **OUTLINE DIMENSIONS AND WIRING DIAGRAM**

Unit: mm


#### **Outline Dimensions**


#### HFE20-1

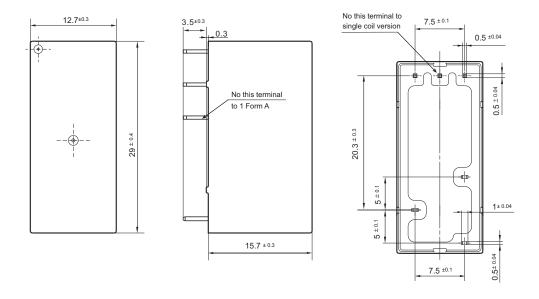


## **Outline Dimensions**


# HFE20-2

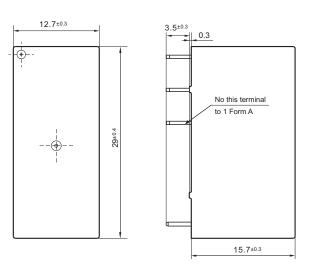


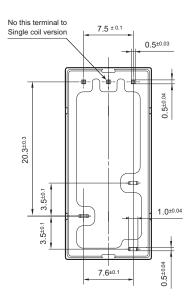

# HFE20-3






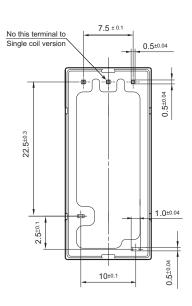


PCB Layout (Bottom view)


HFE20-1




1 Form A, 1 Form B



HFE20-2




1 Form A, 1 Form B




HFE20-3

1 Form A, 1 Form B




Wiring Diagram (Bottom view)


HFE20-3



Positive polarity

Single coil latching, 1 Form A Double coils latching, 1 Form A Single coil latching, 1 Form B Double coils latching, 1 Form B

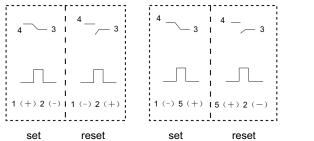






# Wiring Diagram (Bottom view)

# Reverse polarity

Single coil latching, 1 Form A Double coils latching, 1 Form A Single coil latching, 1 Form B Single coils latching, 1 Form B









Wiring Diagram (Bottom view)


HFE20-1 HFE20-2




#### Positive polarity


Single coil latching, 1 Form A Double coils latching, 1 Form A Single coil latching, 1 Form C Double coils latching, 1 Form C








Single coil latching, 1 Form B Double coils latching, 1 Form B







#### Wiring Diagram (Bottom view)

#### Reverse polarity

Single coil latching, 1 Form A Double coils latching, 1 Form A Single coil latching, 1 Form C Double coils latching, 1 Form C

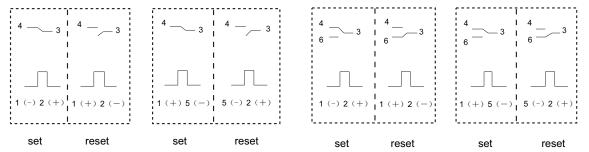


Single coil latching, 1 Form B Double coils latching, 1 Form B



#### (399): Special polarity

Double coils latching



#### Notice

- 1. Relay is on the "reset" or "set" status when being released from stock, with the consideration of shock risen from transit and relay mounting, relay would be changed to "set" or "reset" status, therefore, when application (connecting the power supply), please reset the relay to "set" or "reset" status on request.
- 2. In order to maintain "set" or "reset" status, energized voltage to coil should reach the rated voltage, impulse width should be 5 times more than "set" or "reset" time. Do not energize voltage to "set" coil and "reset" coil simultaneously. And also long energized time (more than 1 min) should be avoided.

#### Disclaimer

This datasheet is for the customers' reference. All the specifications are subject to change without notice.

We could not evaluate all the performance and all the parameters for every possible application. Thus the user should be in a right position to choose the suitable product for their own application. If there is any query, please contact Hongfa for the technical service. However, it is the user's responsibility to determine which product should be used only.

© Xiamen Hongfa Electroacoustic Co., Ltd. All rights of Hongfa are reserved.